


Application

The new X-tra Collection is a TRV specially designed for towel rails and designer radiators. Its new and innovative self-sealing 1/2" valve to radiator connection makes for a seamless, elegant and easy installation.

Small to medium-sized convectors with valves matching in colour or in contrast colours, is also an interesting application for this series of valves.

The towel rails valve set includes a matching lock-shield valve with drain-off function. The valves and sensors are available in Chrome and Inox. The valve set provides the perfect finishing touch for towel rails. The aesthetically pleasing and compact design allows the sensor to be mounted underneath the towel rail, parallel with the wall, avoiding the risk of accidentally knocking the sensor.

Ordering, Set Packs

Type	Description	Chrome	Inox
	Set: right-mounted RAX sensor, thermostat, valve and lockshield valve	013G4227	013G4228

Technical data

Type	Design	Connection		k _v -values [m3/h] with RAX sensor at setting ¹⁾									
		Radiator	System	1	2	3	4	5	6	7	N	N (k _{vs})	
RA-URX	Left mounted angle valve Right mounted angle valve	R ½	M24	0.03	0.06	0.13	0.17	0.23	0.27	0.29	0.34	0.44	

Type	Design	Connection		k _v -values [m ³ /h] at number of turns						
		Radiator	System	0.25	0.50	0.75	1	1.5	2	k _{vs}
RLV-X	Left mounted lockshield valve Right mounted lockshield valve	R ½	M24	0.18	0.36	0.47	0.52	0.58	0.58	0.60

Max. working pressure: 10 bar, Max. differential pressure²⁾: 0,6 bar, Test pressure 16 bar, Max. flow temperature: 120 °C


¹⁾ The k_v-value indicates the water flow (Q) in m³/h at a pressure drop (Δp) across the valve of 1 bar; $k_v = Q: \sqrt{\Delta p}$.
At setting N the k_v-value is stated according to EN 215, at X_p = 2K i.e. the valve is closed at 2 °C higher room temperature.
At lower settings the X_p value is reduced to 0.5K of the setting value 1.
The k_{vs}-value states the flow Q at a maximum lift, i.e. at fully open valve at setting N.

²⁾ The maximum differential pressure specified is the maximum pressure at which the valves give satisfactory regulation.
As with any device which imposes a pressure drop in the system, noise may occur under certain flow/pressure conditions.
The differential pressure can be reduced by the use of the Danfoss differential pressure regulators.

Pre-setting

Danfoss pre-settable valve bodies incorporate easy setting adjustment rings with clearly engraved

setting markers scaled from 1 - 7 and N. Setting values can be set quickly and precisely, without the need for tools, as follows:

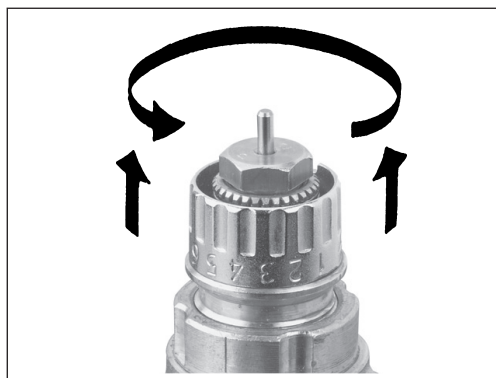


- Remove protective cap or sensor element
- Lift setting ring
- Turn anti-clockwise to the desired engraved setting value
- Allow setting ring to spring back into position

The preset level can be selected in 0.5 increments between 1 and 7 (see chart on page 3 for flow rates).

At setting N the valve is fully open (flushing option).

Capacities

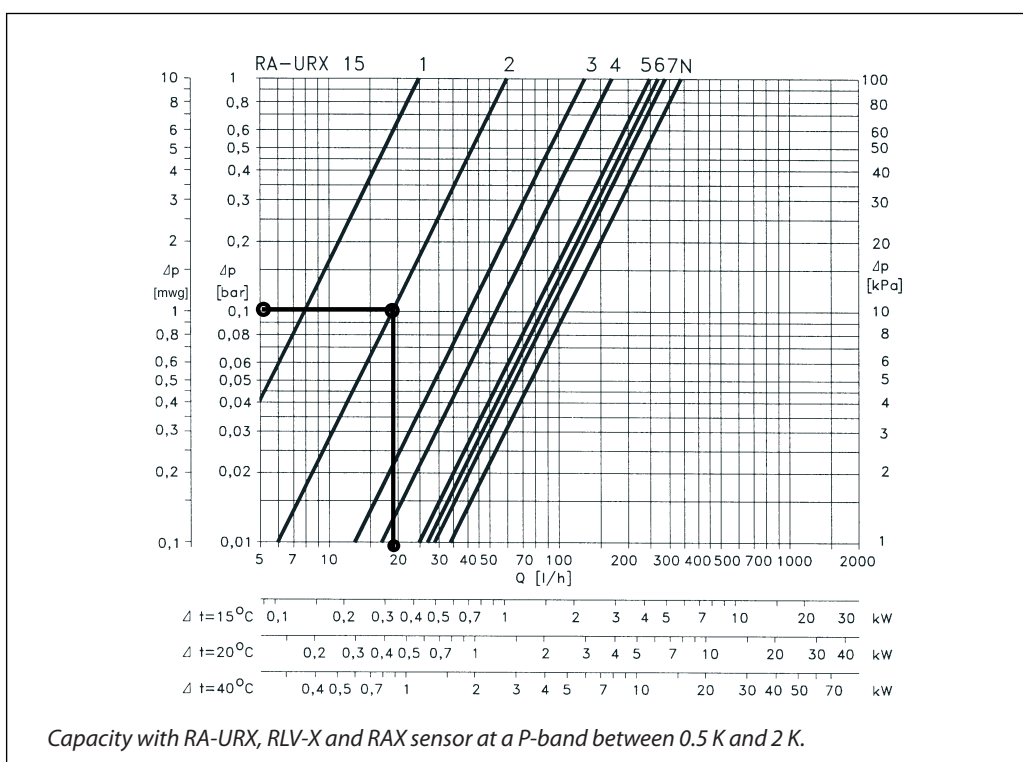

Sizing example

Required heat: 0.65 kW
Cooling across radiator: 30 °C.
Flow through radiator:

$$Q = \frac{0.65}{30 \times 1.16} = 0.18 \text{ m}^3/\text{h} = 0.005 \text{ l/s.}$$

Pressure drop across valve: $\Delta p = 1 \text{ mwg}$.
Valve setting: "2"

Alternatively the setting can be read directly in the table "Ordering and technical data":

$$k_v = \frac{Q (\text{m}^3/\text{h})}{\sqrt{\Delta p (\text{bar})}}$$

Valve presetting when using RTX sensor

Due to the function of the RTX sensor its influence on the hydraulic balance of the heating system is very limited. Consequently it is seldom required to adjust the kv-setting of the valve from the factory setting "N".



The table shows the reduced flow in m³/h when applying different kv-settings:

Valve pre-setting	2K	5K
1	0,03	0,03
2	0,07	0,07
3	0,12	0,13
4	0,16	0,18
5	0,19	0,24
6	0,21	0,27
7	0,22	0,29
N	0,23	0,33

Construction


RA-URX - Gland seal for RAX

1. Protective cap
2. Gland seal
3. Pressure pin
4. Return spring
5. Setting cylinder
6. Valve body
7. Allen screw
8. Self-sealing gland

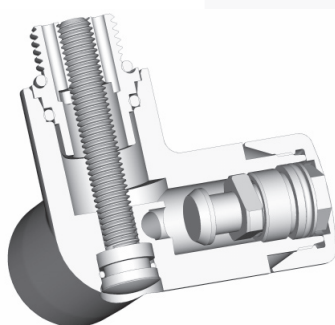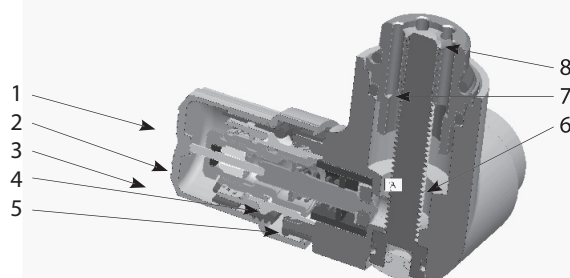

RLV-X

1. Self-sealing gland
2. Allen screw
3. Valve body
4. Shut-off facility
5. Cylindric guide
6. Cover cap

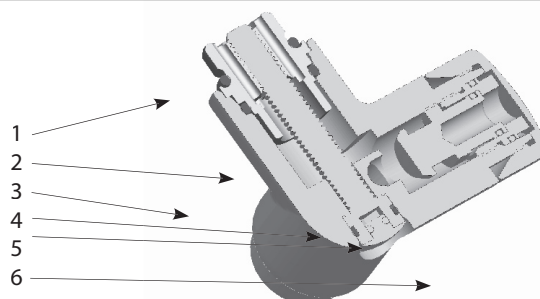

The valve assembly features valve body and a self-sealing gland pre-mounted with 2 O-rings - one for sealing against the radiator and one for sealing in the valve housing.

The Allen-screw features an O-ring seal to ensure a tight seal against the valve body.

In situations where radiator in- and outlets are not suitable for O-ring seal, conventional sealing material is used.

Materials in contact with water

Setting cylinder	PPS
Spindle	Ms, resistant against dezincification
O-rings	EPDM
Valve cone	NBR
Valve body	Ms 58

**Spare parts
and accessories**


Spare parts	Code no.
Gland seal for RA-URX valve with RAX sensor	013G0290

Accessories	Code no.
Drain and fill tap	003L0152

Fittings

Relevant compression fittings are delivered by Jaga


Installation

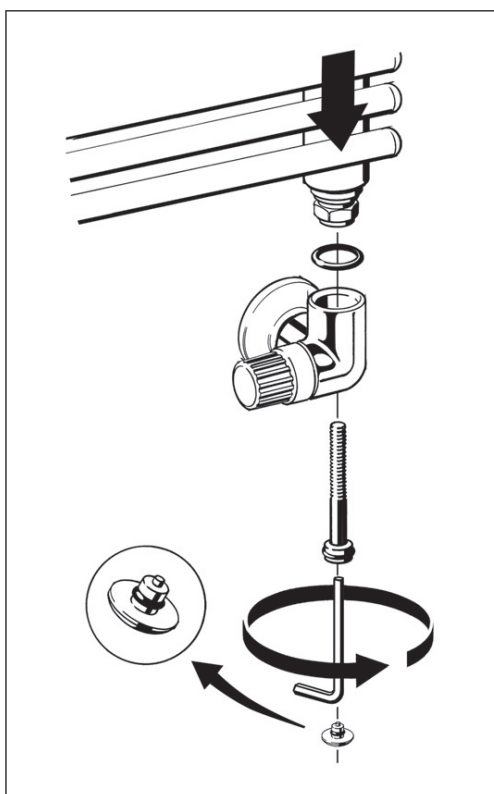


The self-sealing gland is mounting in radiator inlet and outlet using a 17 mm hexagonal key.

Valve and lockshield valve has matching design. The yellow valve cap can temporarily be used to open and shut the valve. The lockshield valve features shut-off and draining facility.


All O-rings are of the EPDM-type which means no mineral oils or grease are to be used.

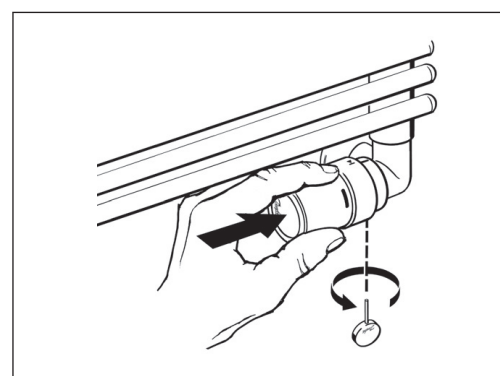

**Shut-off, filling
and draining**

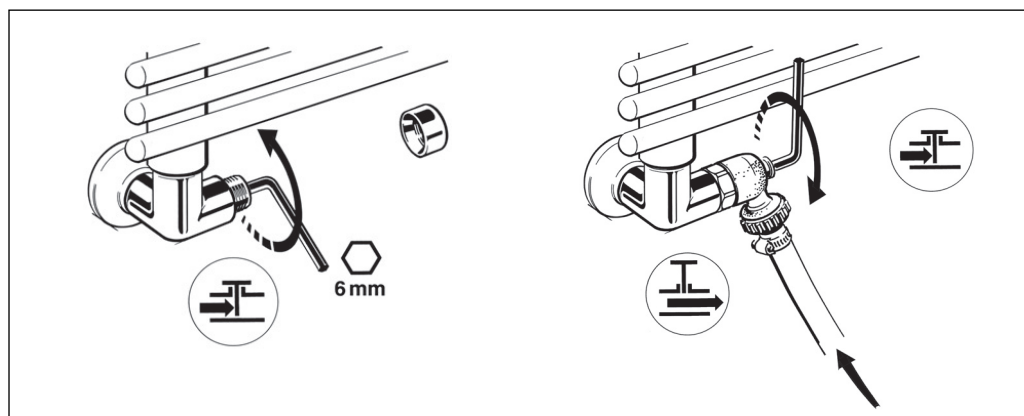

Dimensions

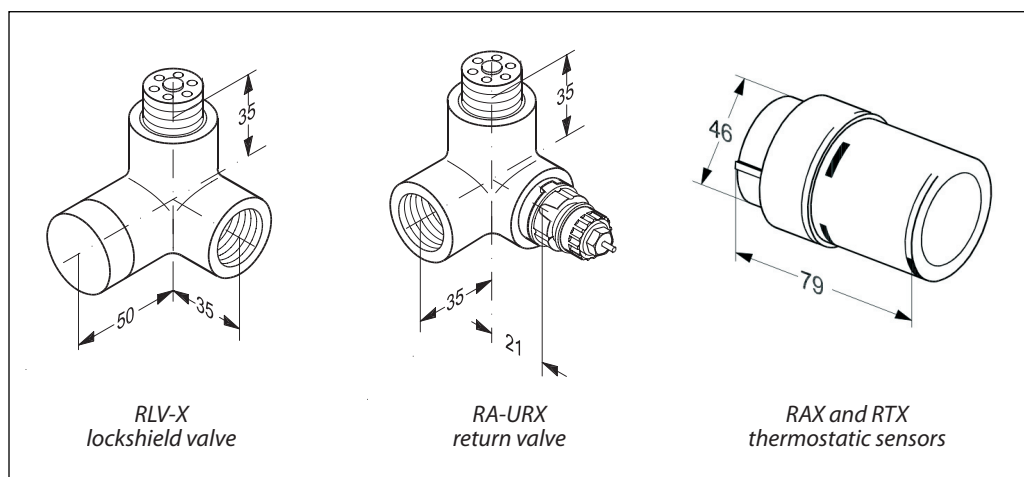

Danfoss can accept no responsibility for possible errors in catalogues, brochures and other printed material. Danfoss reserves the right to alter its products without notice. This also applies to products shown on other promotional literature. Danfoss can be held liable for damages only if it can be proven that the damage is a direct result of a defect in the product. All trademarks in this material are property of the respective companies. Danfoss and the Danfoss logo are trademarks of Danfoss A/S. All rights reserved.