




Venttiili




KSU



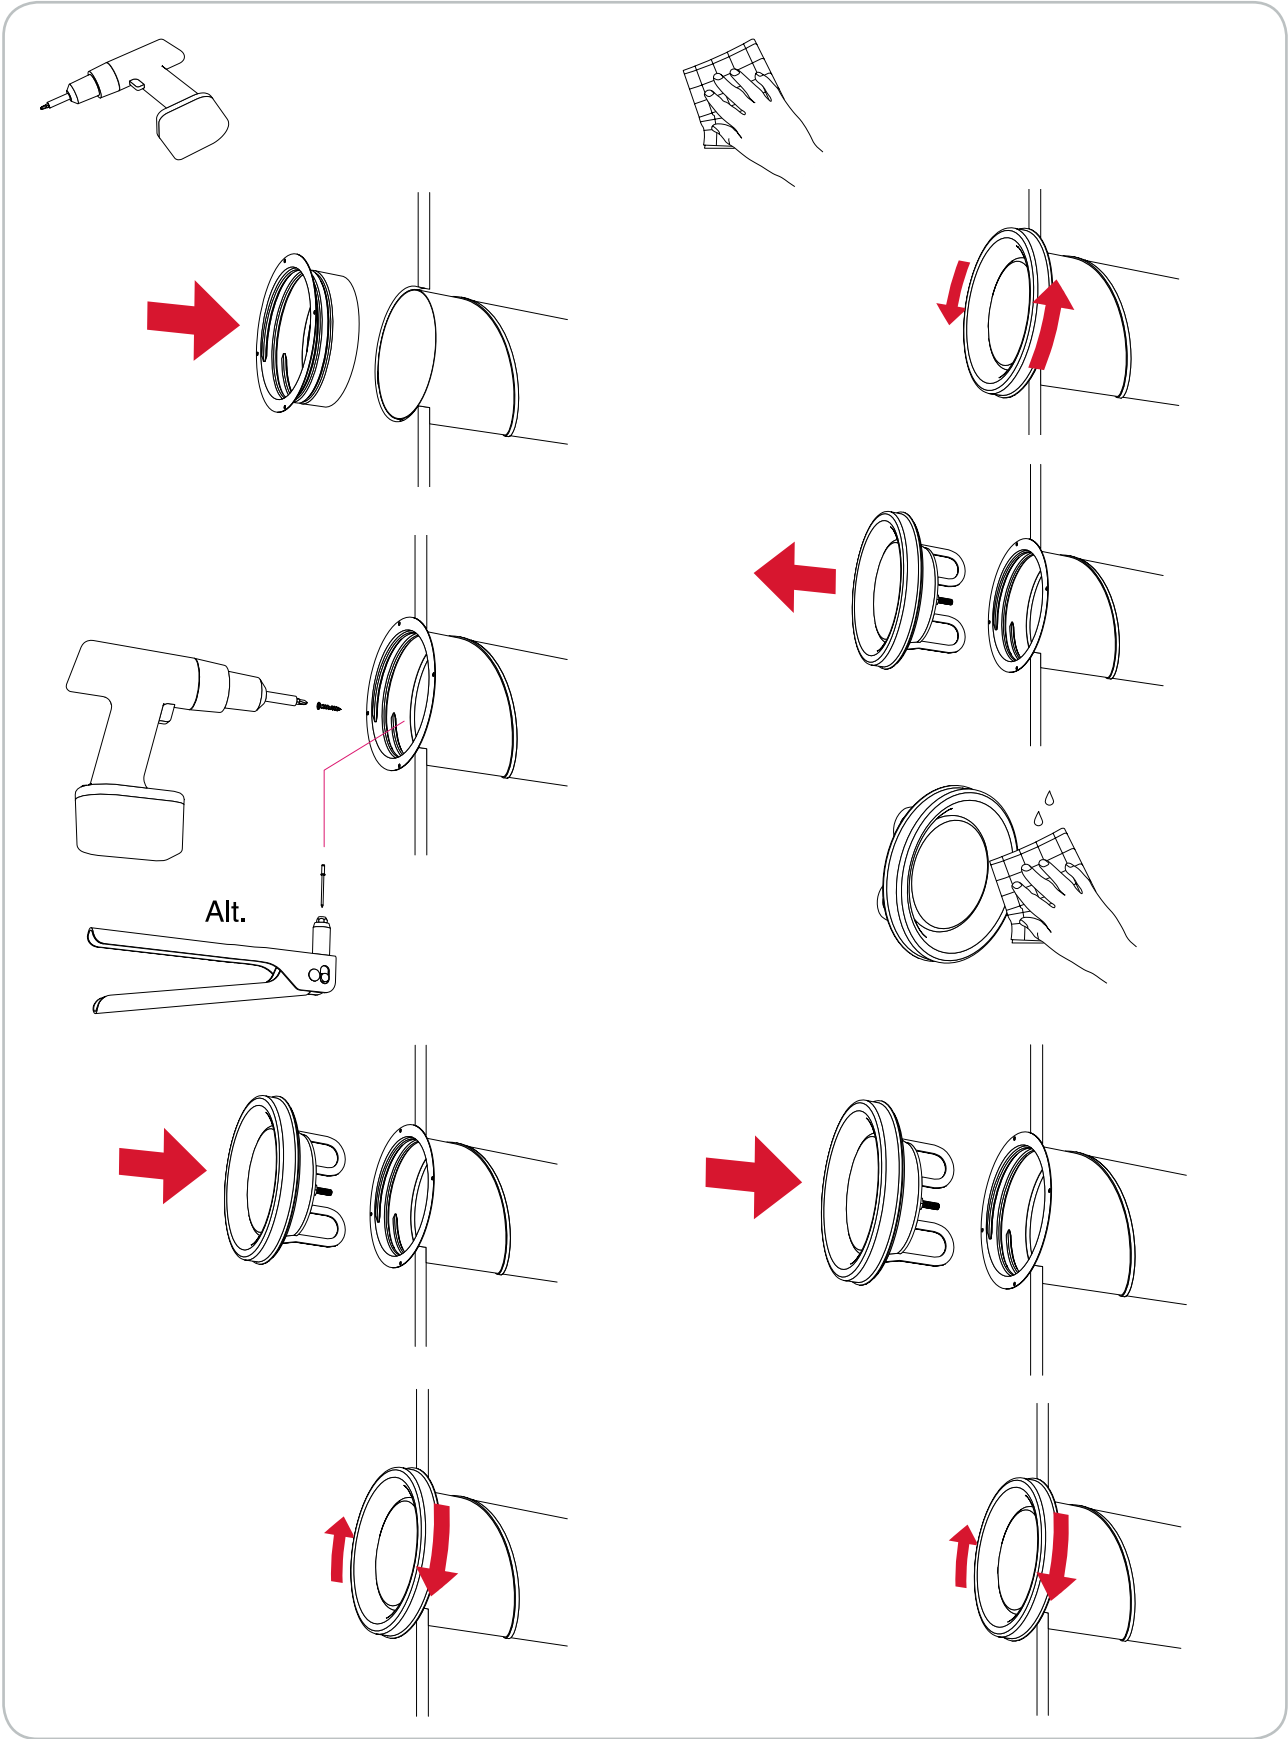

Venttiili

KSU

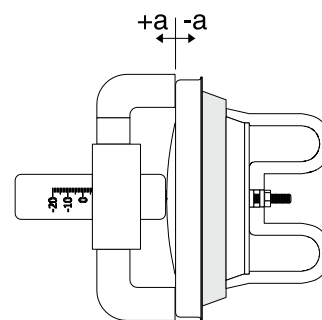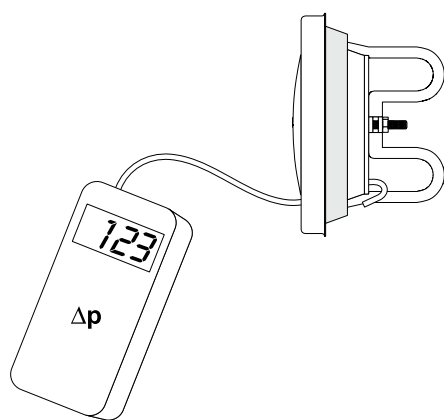

Ø mm	Venttiili Asennus- paikka	Asento a [mm]									
100	Kanava Käyrä 90° T-haara	a	-15	-12	-10	-5	0	5	10		
		k	0,459	0,676	0,861	1,36	1,82	2,32	2,75		
			0,505	0,841	1,00	1,40	1,86	2,35	2,77		
			0,576	0,850	1,01	1,42	1,89	2,35	2,66		
		a	-10	-5	0	5	10				
		125	Kanava Käyrä 90° T-haara	k	1,29	1,93	2,59	3,29	3,91		
k	1,24			1,90	2,61	3,33	3,90				
	1,53			2,20	2,88	3,41	4,27				
		a	-10	-5	0	5	10	15			
		150	Kanava Käyrä 90° T-haara	k	1,81	2,69	3,42	4,48	5,17	6,09	
				k	2,01	2,75	3,47	4,37	5,29	6,21	
	1,98			2,89	3,84	4,64	5,61	6,43			
		a	-10	-5	0	5	10	15			
		160	Kanava Käyrä 90° T-haara	k	1,80	2,62	3,62	4,57	5,58	6,46	
				k	1,50	2,50	3,48	4,50	5,39	6,52	
	2,04			2,92	4,00	4,81	5,87	6,57			
		a	-3	0	5	10	15	20	25		
		200	Kanava Käyrä 90° T-haara	k	2,02	2,72	3,85	5,19	6,32	7,63	8,72
				k	1,65	2,62	3,71	5,21	6,07	7,40	8,60
	2,11			3,00	3,90	5,46	6,54	7,80	8,90		