
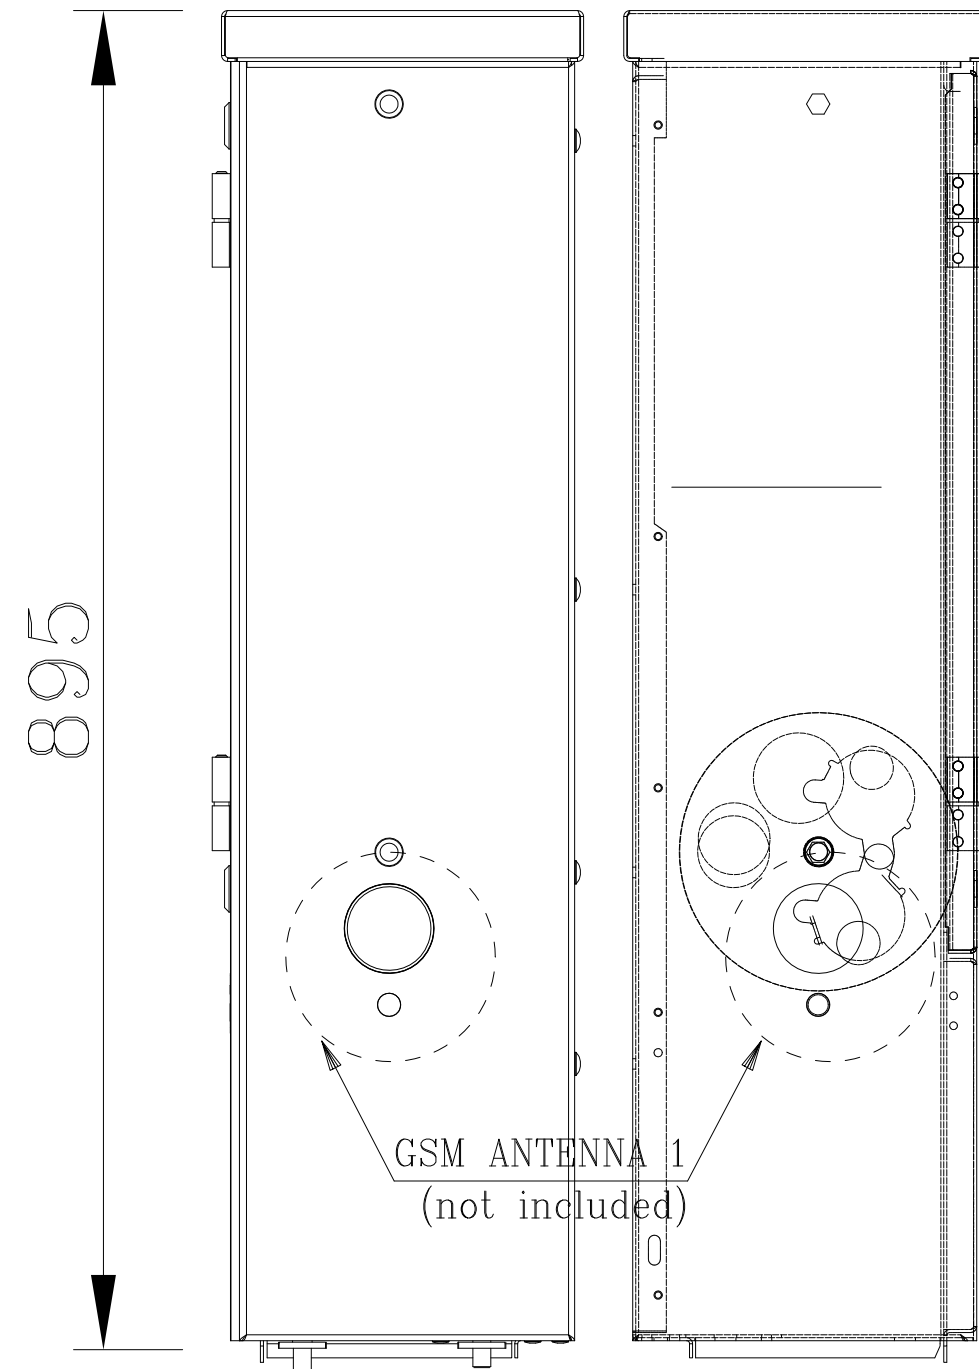


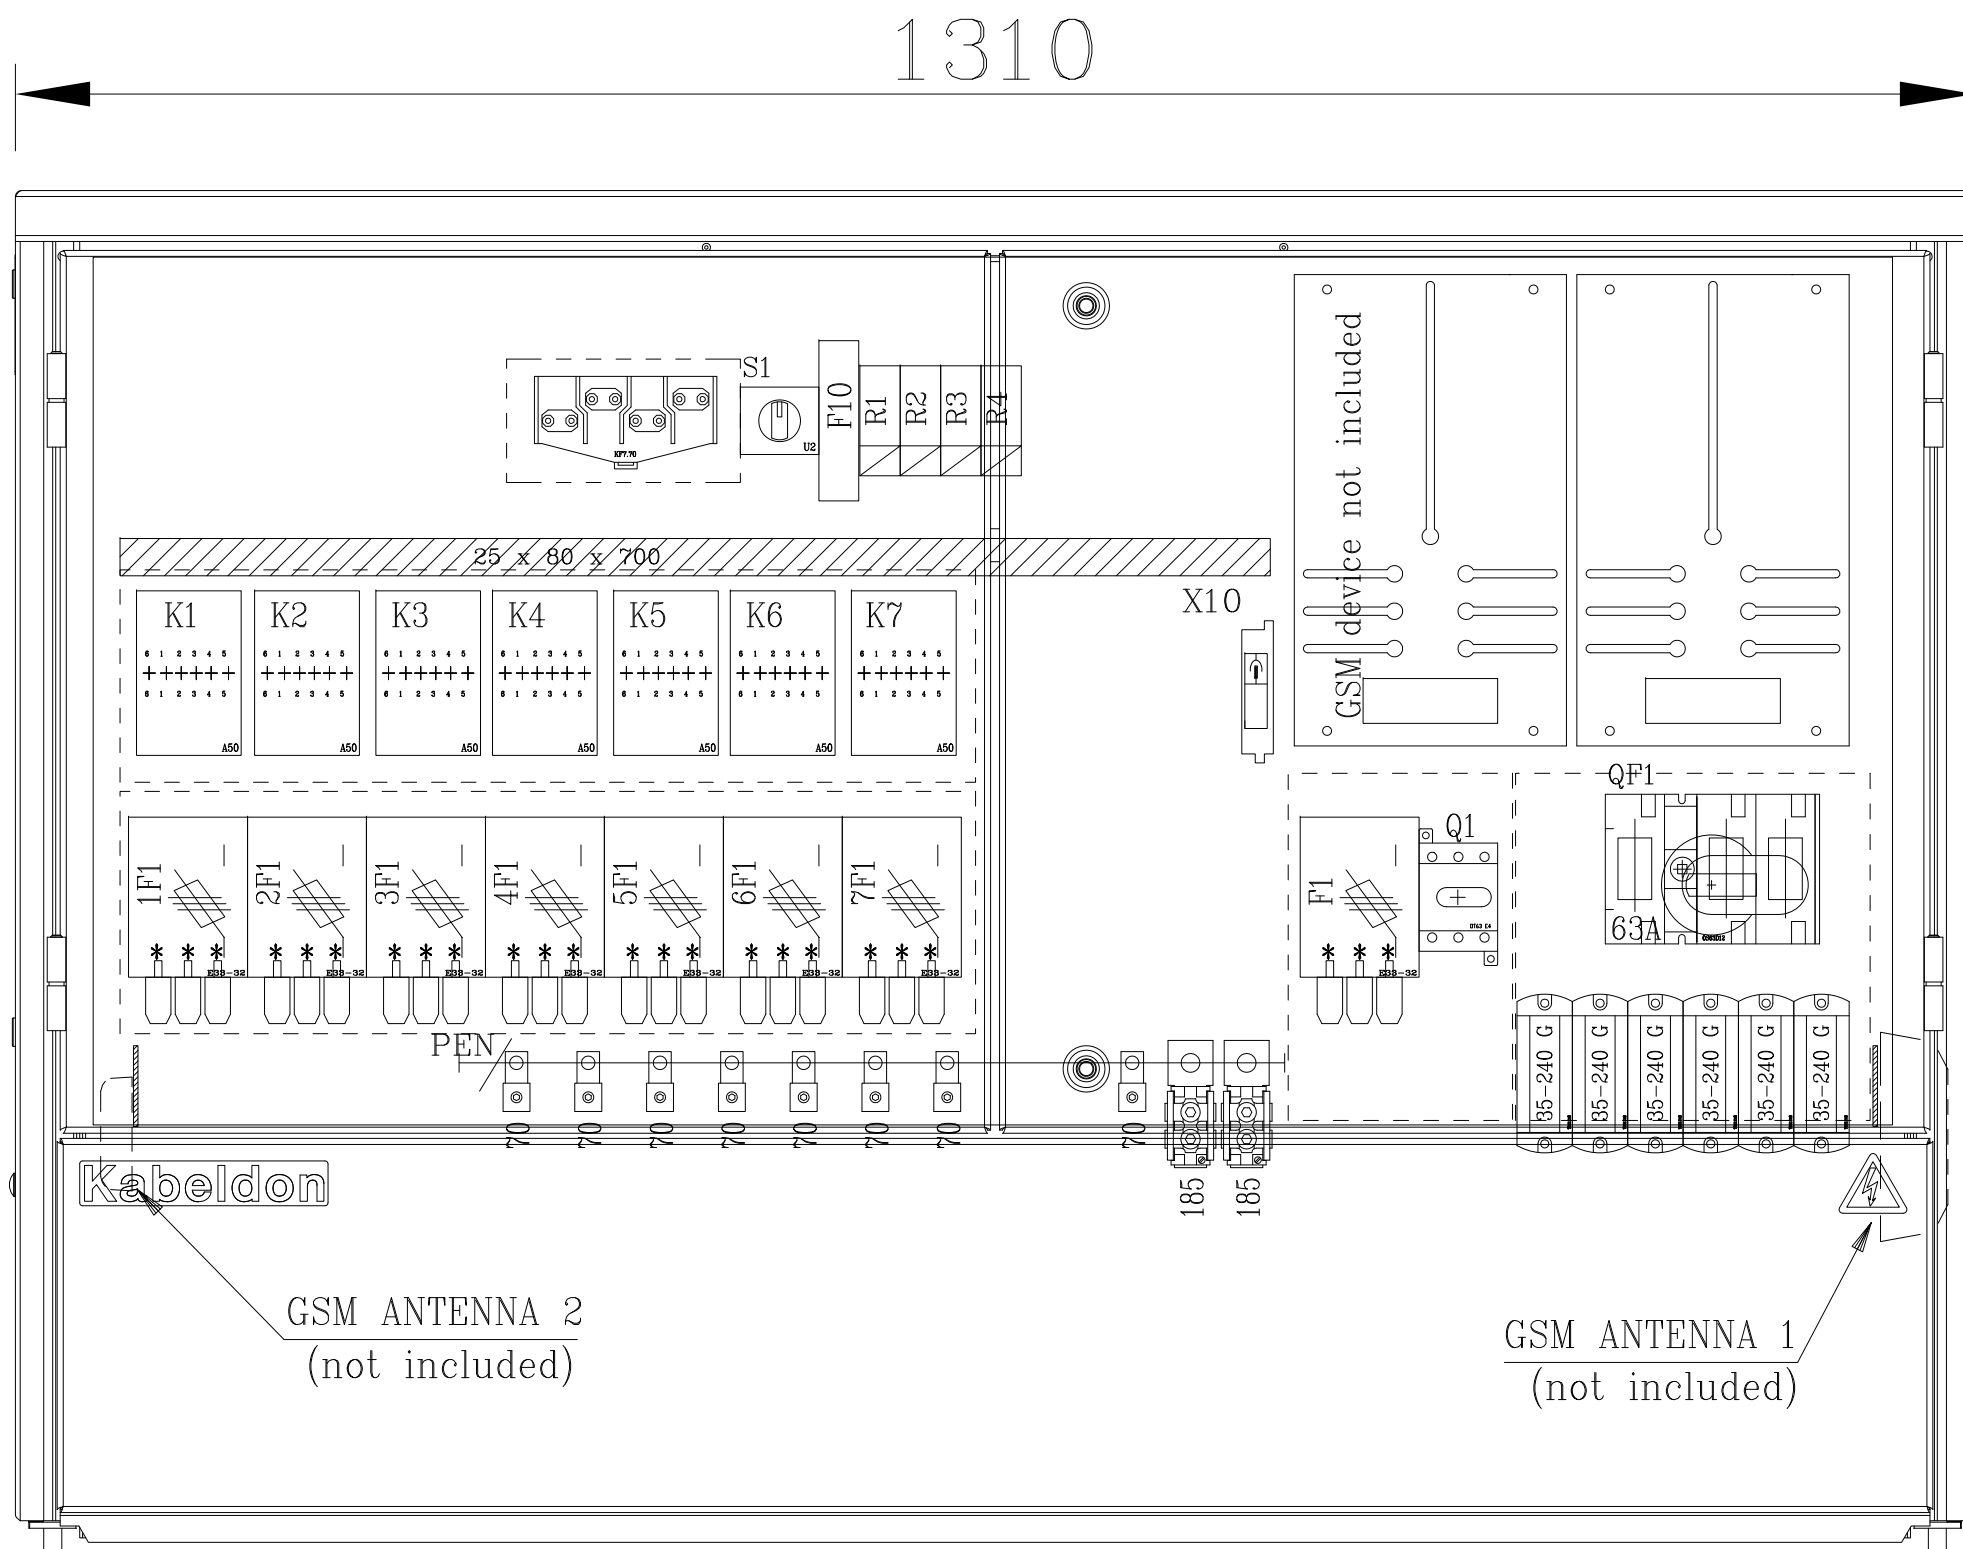

*-Holes must be made in the protection cover to test the voltage in outlets of the fuses

SDC 098LD + KSMP-S 98

Tyyppi	SDC	Syvyys	242	[mm]	In	63	[A]	Un	400	[V]	Icw	[kA]	Ipk	[kA]	Tunnus	SDC098LD-K/KV7+1R/E17	Kojesijoitus	Muutos		Kpl			
	ABB AS Low Voltage Systems Factory Paldiski mnt. 21 76601 Keila, ESTONIA Tel.:+372 6712700 Fax:+372 6747463						Suunn. 11-03-13/RP		Asiakas					Project						Lehti/Lehdistä		1 / 1	F-EE-ATLVS-12v01
								Piirustus No											724362_GA V1				