

RCBO - MDC

Technical data

| | T | YPE | | | MD | C 45 | MD | C 60 | MD | 100 | MDC 100 MA |
|-----------------------|---------------------|------------------------------|-----------|--------|----------------|----------------------|----------------|----------------------|----------------|----------------------|------------------------------------|
| | | | | | | | | | | | |
| Standards | | | | | | 61009-1 51009-2-1 | | 61009-1 51009-2-1 | | 61009-1 61009-2-1 | IEC EN 61009-1 IEC EN 61009-2-1 |
| Rated current (In) | | | | (A) | 6- | -32 | 6 | -32 | 6 | -32 | 6-32 |
| Utilization category | | | | | | A | | A | | A | A |
| Rated operational v | oltage (Ue) | | | (V AC) | 230/400 | - 240/415 | 230/400 | - 240/415 | 230 | - 240 | 110 |
| Insulation voltage (l | Ui) | | | (V) | 5 | 00 | 5 | 00 | | i00 | 500 |
| Rated frequency | | | | (Hz) | 50 | /60 | 50 | /60 | 50 |)/60 | 50/60 |
| Rated impulse with | stand voltage (Uimp | o) | | (kV) | | 4 | | 4 | | 4 | 4 |
| Overvoltage categor | y: | | | | | III | | III | | III | III |
| Number of poles | | | | | 1+N,2 | 3, 4 | 1+N,2 | 3, 4 | 2 | 2, 3 | 2 |
| Energy limiting class | s (B and C) | | | | 3 | 1 | 3 | 1 | | 3 | 3 |
| Breaking capacity | 1 | | | | | | | | | | |
| | | lcn | | (A) | 45 | 500 | 60 | 000 | 10 | 000 | 10000 |
| | IEC/EN 61009-1 | lcs | | (A) | 1 | lcn | 1 | lcn | 0.7 | '5 Icn | 0.75 lcn |
| Alternating current | | 1 | 230/240 V | (kA) | 6 | - | 10 | - | | 15 | 15 |
| | IEC/EN 60947-2 | lcu | 400/415 V | (kA) | - | 4,5 | - | 6 | | - | - |
| | | lcs | | (kA) | 100 | % Icu | 75% lcu | 100% lcu | 50 | % Icu | 50% lcu |
| Rated residual opera | ating current (I∆n) | | | (mA) | | | | | | | |
| • | | | | | | 30 | | 30 | | 30 | 30 |
| | | | AC | | | 00 | | 00 | | 100 | - |
| | | | | | | 30 | _ | 30 | | 30 | 30 |
| Гуре | | | A | | | - | | - | | 00 | - |
| iype | | | ^ | | | 00 | | 00 | | 100 | _ |
| | | | A[IR] | | | - | | 30 | | 30 | |
| | | | A[S] | | | _ | | 00 | | - | _ |
| | | | F | | | | _ | 30 | | 30 | _ |
| | | | <u>'</u> | | _ | | 250 (for AC | | | and A types) | |
| Level of immunity (| 8/20 µs) | | | (A) | 2 | 50 | | , A[S], F types) | | ype A[IR], F) | 250 |
| Residual making an | d breaking capacity | (IΔm) | | (A) | 45 | 500 | 45 | 500 | 4 | 500 | 4500 |
| Voltage independen | t working: | | | | Υ | ES | Υ | ES | ١ | 'ES | YES |
| Wiring | | cable | rigid | | ≤ 1x35 - ≤ 2x1 | 6 - ≤ 1x16+2x10 | ≤ 1x35 - ≤ 2x1 | 6 - ≤ 1x16+2x10 | ≤ 1x35 - ≤ 2x1 | 6 - ≤ 1x16+2x10 | ≤ 1x35 - ≤ 2x16 - ≤ 1x16+2x |
| ••••• | | section (mm²) ⁽¹⁾ | flexible | | ≤ 1x35 - ≤ 2x1 | 6 - ≤ 1x16+2x10 | ≤ 1x35 - ≤ 2x1 | 6 - ≤ 1x16+2x10 | ≤ 1x35 - ≤ 2x1 | 6 - ≤ 1x16+2x10 | ≤ 1x35 - ≤ 2x16 - ≤ 1x16+2x |
| Electrical endurance | | | | | 10 | 000 | 10 | 000 | 10 | 000 | 10000 |
| Mechanical enduran | ce | | | | 20 | 000 | 20 | 000 | 20 | 1000 | 20000 |
| Max. no. of usable n | nodular accessories | | | | | 2 | | 2 | | 2 | 2 |
| Upline/Downline po | wer supply | | | | Y | ES | Y | ES | \ | 'ES | YES |
| Status displayed | | | | | Υ | ES | Υ | ES | \ | 'ES | YES |
| Mounting position: | | | | | | ny | | ny | ć | any | any |
| Rated tightening tor | rque: | | | (Nm) | | 2 | | 2 | | 2 | 2 |
| Screwdriver suggest | ed | | | | P | Z2 | | Z2 | F | 722 | PZ2 |
| Degree of protection | 1 | terminals | | | | 20 | | 20 | | 20 | IP20 |
| | - | front | | | | 40 | | 40 | ll ll | P40 | IP40 |
| Pollution degree: | | | | | - | 2 | | 2 | | 2 | 2 |
| Tropicalization | | | | | | RH 95% | | RH 95% | | RH 95% | 55°C - RH 95% |
| Reference temperat | | | | (°C) | | 30 | | 30 | | 30 | 30 |
| Operating temperati | | | | (°C) | | +60 (2) | | +60 (2) | | +60 (2) | -25 +60 ⁽²⁾ |
| Stocking temperatu | | | | (°C) | |) +70 | | +70 | | 0 +70 | -40 +70 |
| Double connection (| cable+fork busbar) | | | | | tream terminals) | - | tream terminals) | | stream terminals) | yes (only downstream termina |
| Weight per pole | | | | (g) | | 20 | | 20 | | 20 | 120 |
| Curve | | | | | | С | С | В | С | В | С |
| Rated currents avail | lable (In) | | | (A) | | 6 | 6 | 6 | 6 | 6 | 6 |
| | | | | | 1 | 10 | 10 | 10 | 10 | 10 | 10 |
| | | | | | | 13 | 13 | 13 | 13 | 13 | 13 |
| | | | | | | 16 | 16 | 16 | 16 | 16 | 16 |
| | | | | | | 20 | 20 | 20 | 20 | 20 | 20 |
| | | | | | 2 | 25 | 25 | 25 | 25 | 25 | 25 |
| | | | | | | | | | | | |

⁽¹⁾ Minimum cable section is 1mm²

 $^{^{(2)}}$ With temperatures greater than 30°C, derating of In rated current is expected



ADD-ON RCD - BD - BDHP

Technical data

| ТҮРЕ | | | В | D | BDHP | BDHP ADJUSTABLE |
|------------------------------------------------------|---------------|----------|--------------------------------|---------------------------------|--------------------------------------------------|-------------------------------|
| | | | 444 | | | A PARTIE THE |
| Standards | | | | 19-1 Annex G 1009-2-1 | IEC EN 61009-1 Annex G IEC EN 61009-2-1 | EN 60947-2 app. B |
| Rated current (In) | | (A) | ≤ 25 | ≤ 63 | ≤ 125 | ≤ 125 |
| Rated operational voltage (Ue) | | (V AC) | 230 | /400 | 230/400 | 400 |
| Insulation voltage (Ui) | | (V) | 51 | 00 | 500 | 500 |
| Rated frequency | | (Hz) | 50 | /60 | 50/60 | 50 |
| Rated impulse withstand voltage (Uimp) | | (kV) | | 4 | 4 | 4 |
| Overvoltage category: | | | ı | II | III | III |
| Number of poles | | | 2, | 3,4 | 2,3,4 | 4 |
| Rated residual operating current (IΔn) | | (mA) | | | | |
| | | | 10 ⁽¹⁾ | - | - | - |
| | | | 30 | 30 | 30 | - |
| | | AC | 300 | 300 | 300 | - |
| | | | 500 | 500 | - | - |
| | | | 30 | 30 | 30 | - |
| Туре | | A | 300 | 300 | 300 | - |
| | | | 500 | 500 | - | - |
| | | A[IR] | - | 30 | - | - |
| | | a (c) | - | 300 | 300 | - |
| | | A[S] | - | 1000 | 1000 | - |
| | | A[Adj.] | - | - | - | 300 - 500 - 1000 - 3000 |
| Adjustable tripping time (t) | | (ms) | | - | - | 0 - 60 - 150 |
| Level of immunity (8/20 μs) | | (A) | 250 (for AC 3000 (for A[IR] | and A types) and A[S] types) | 250 (for AC and A types) 3000 (for A[S] type) | 3000 |
| Residual making and breaking capacity (I Δ m) | | (A) | Icn circui | t breaker | Icn circuit breaker | Icn circuit breaker |
| Voltage independent working: | | | Υ | ES | YES | YES |
| Wiring | cable | rigid | ≤ 1x35 - ≤ 2x16 | 5 - ≤ 1x16+2x10 | ≤ 1x70 - ≤ 2x25 - ≤ 2x25+1x10 | ≤ 1x70 - ≤ 2x25 - ≤ 2x25+1x10 |
| ······································ | section (mm²) | flexible | ≤ 1x35 - ≤ 2x10 | 5 - ≤ 1x16+2x10 | ≤ 1x50 - ≤ 2x25 - ≤ 3x16 | ≤ 1x50 - ≤ 2x25 - ≤ 3x16 |
| Upline/Downline power supply | | | Y | ES | YES | YES |
| Mounting position: | | | a | ny | any | any |
| Rated tightening torque: | | (Nm) | : | 2 | 3.5 / 3 (terminal) | 3.5 / 3 (terminal) |
| Screwdriver suggested | | | P | Z2 | PZ2 | PZ2 |
| Degree of protection – | terminals | | IP | 20 | IP20 | IP20 |
| | front | | | 40 | IP40 | IP40 |
| Pollution degree: | | | | 2 | 2 | 2 |
| Tropicalization | | | | RH 95% | 55°C - RH 95% | 55°C - RH 95% |
| Reference temperature | | (°C) | 3 | 0 | 30 | 30 |
| Operating temperature | | (°C) | -25 | +40 | -25 +40 | -25 +40 |
| Stocking temperature | | (°C) | | +70 | -40 +70 | -40 +70 |
| Weight per pole | | (g) | 10 | 00 | 200 | 200 |

[™] Only for 2P versions



RCCB - IDP

Technical data

| ТҮРЕ | | IDP NA | IDP | IDP 4P (3M) | SD K | IDP 125A |
|----------------------------------------------------------|-------------------|---------------------------------|----------------------------------------------------------------|----------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------|
| | | - | 0 | | | 12/2/2/2 |
| | | *** | | * * * * | The state of the s | |
| | | | | | | * E |
| | | | Contract Contract | | Ge L | 6.05 M |
| | | 100 | 1000 | **** | | 1000 |
| | | | IEC EN 61008-1 | | | |
| | | IEC EN 61008-1 | IEC EN 61008-2-1 | IEC EN 61008-1 | IEC EN 61008-1 | IEC EN 61008-1 |
| itandard | | IEC EN 61008-2-1 | IEC EN 62423 | IEC EN 61008-2-1 | IEC EN 61008-2-1 | IEC EN 61008-2-1 |
| | | | (type F and B) | | 120 211 01000 2 1 | |
| lated current (In) | (A) | 25-40-63 | 25-80 | 25-40 | 80-100 | 125 |
| ated operational voltage (Ue) | (V a.c.) | 230/400 - 240/415 | 230/400 - 240/415 | 400 | 400 - 415 | 400 |
| nsulation voltage (Ui) | (V) | 500 | 110 (for MA versions) 500 | 500 | 400 | 500 |
| Rated impulse withstand voltage (Uimp) | kV | 4 | 4 | 4 | 4 | 4 |
| vervoltage category | | III | III | III | III | III |
| lated frequency | (Hz) | 50 2 (Up to 40A) | 50/60 | 50/60 | 50 | 50 |
| oles | | 4 (Up to 63A) | 2, 4 | 4 | 4 | 4 |
| | | | 2 (2P) | | | |
| Number of modules | | 2 (2P) | 4 (4P) | 3 | 4 | 4 |
| | | 4 (4P) | 4 (2P/4P type B) | | | |
| lated residual operating current (I∆n) | (mA) | | | | | |
| | | - | 10 ⁽¹⁾ | - | - | |
| | | 30 | 30 | 30 | 30 | 30 |
| A | C | 300 | 100 300 | 100 300 | 300 | 300 |
| | | - | 500 | 500 | - | 500 |
| _ | | - | 10 (1) | - | - | - |
| ype . | | 30 | 30 | 30 | 30 | 30 |
| ype A | 1 | 300 | 100 300 | 100 300 | 300 | 300 |
| | | - | 500 | 500 | - | 500 |
| Ī | R - Impulse | - | 30 | - | 30 | - |
| ri | esistant | - | 300 | - | - | - |
| S | - Selective | - | 300 500 | - | 300 | <u> </u> |
| F | | - | 30 | - | - | - |
| B | ı | - | 30 | - | - | - |
| | | - | 300 | - | - 250 (Tues AC A) | - |
| evel of immunity (8/20μs) | (A) | 250 | 250 (Type AC - A) 3000 (Type A[IR] - A[S] - F - B) | 250 | 250 (Type AC - A) 3000 (Type A[IR] - A[S]) | 250 |
| Residual making and breaking capacity (Idm) | (A) | 10 x In (630A min) | 10 x In (630A min) | 630 | 800 (80A) - 1000 (100A) | 1250 |
| Making and breaking capacity (Im) | (A) | 10 x In (630A min) | 10 x In (630A min) | 630 | 800 (80A) - 1000 (100A) | 1250 |
| oltage independent working | | yes | yes | yes | yes | yes |
| | rigid flexible | | ≤ 1x35 - ≤ 2x16 - ≤ 1x16+2x10 ≤ 1x35 - ≤ 2x16 - ≤ 1x16+2x10 | | <u>≤35</u> ≤35 | <u>≤50</u> ≤50 |
| electrical endurance | HEAIDIE | 5000 | 10000 | 5000 | 4000 | 10000 |
| Mechanical endurance | | 10000 | 20000 | 10000 | 10000 | 10000 |
| Jpstrem / Downstream supply | | yes | yes | yes | yes | yes |
| Aounting position Rated tightening torque | (Nm) | any 2 | any 3 | any 2 | any 2 | any 3 |
| icrew type | (14111) | PZ2 | PZ2 | PZ2 | PZ2 | PZ2 |
| Pollution degree | | 2 | 2 | 2 | 2 | 2 |
| ire resistance | | IDAO | | IEC 60695-2-11 according w | | ID40 |
| P degree (inside the distribution board) Tropicalization | | IP40 55°C - UR 95% | IP40 55°C - UR 95% | IP40 55°C - UR 95% | IP40 55°C - UR 95% | IP40 55°C - UR 95% |
| nstallation altitude | (m) | ≤ 2000 | ≤ 2000 | ≤ 2000 | ≤ 2000 | ≤ 2000 |
| perating temperature (average daily temperature ≤35°C) | (°C) | -5 ÷ +40 | -25 ÷ +60 ⁽³⁾ | -25 ÷ +40 | -25 ÷ +40 | -25 ÷ +60 ⁽³⁾ |
| torage temperature | (°C) | -40 ÷ +70 | -40 ÷ +70 | -40 ÷ +70 | -35 ÷ +60 | -40 ÷ +70 |
| louble connection (sable : fork bushar) | | no (for 2P) | yes | yes | yes | no |
| Double connection (cable + fork busbar) | | yes (only downstream for 4P) | (Upstream and downstream) | (Upstream and downstream) | (Upstream and downstream) | no |
| ignalization of the relay tripping | | no | VPS | no | no | no |
| | | | yes 175 (2P), 320 (4P) | | 110 | 110 |
| Neight of device | (g) | 160 (2P), 300 (4P) | 275 (2P TYPE B) | 280 | 350 | 555 |
| | | 1 | 340 (4P TYPE B) | | | |

⁽¹⁾ Up to 25A

⁽³⁾ With temperatures greater than 40°C, derating of In rated current is expected

| | | | RATED C | ONDITION/ | AL RESIDU <i>i</i> | AL SHORT-C | IRCUIT CURI | RENT IΔc (k | (A) | | | |
|---------|-----------|---------|---------|-----------|--------------------|------------|-------------|-------------|-----|----|------|------|
| Rated o | urrent In | 25A / 4 | OA (NA) | | 25A / 40A | | 63A(NA) | 63A | 80A | | 100A | 125A |
| Po | oles | 2P | 4P | 2P | 4P | 4P (3M) | 2P/4P | 2P/4P | 2P | 4P | 4P | 4P |
| | gG 63A | 6 | 6 | 10 | 10 | 6 | 6 | 10* | - | - | - | - |
| Fuse | gG 80A | | - | - | - | - | - | 10 | 6 | 10 | - | - |
| ruse | gG 100 | | - | - | - | - | - | - | - | - | 10 | - |
| | gG 125 | | - | - | - | - | - | - | - | - | - | 10 |
| | MTC 45 | | | 4,5 | | | | - | | - | - | - |
| | MTC 60 | | | 6 | | | | - | | - | - | - |
| | MTC 100 | | | 10 | | | | - | | - | - | - |
| | MT 45 | | | 4,5 | | | | - | | - | - | - |
| MCB | MT 60 | | | 6 | | | | 5 | | - | - | - |
| | MT 100 | | | 10 | | | 1 | 0 | | - | - | - |
| | MT 250 | | | 10 | | | 1 | 0 | | - | - | - |
| | MTHP 160 | | | - | | | 1 | 0 | 10 | | 10 | 10 |
| | MTHP 250 | | | 10 | | | 1 | 0 | | - | - | - |

 $^{^{\}star}$ Only F and B type RCCBs

⁽²⁾ Minimum cable section is 1.5mm²



MDC 45 - 60 - 100 compact residual current circuit breakers with overcurrent protection

Technical characteristics

For circuit overcurrent protection and the residual current protection of devices and services, there are the MDC 45, MDC 60 and MDC 100 compact residual current circuit breakers with overcurrent protection.

The MDC compact miniature circuit breakers with residual current release have a thermomagnetic part with the same characteristics as the MTC circuit breakers. The residual current release - assembled in the factory inside the same modular shell - is available in AC, A, A[IR] impulse resistant, A[S] selective and F versions with a rated residual current of 30, 100 and 300 mA.

Some advice about selection and installation

Due to their design, RCCBs are sensitive devices and therefore more exposed to phenomena that can cause an untimely trip (the RCCB trips without a real fault). The untimely trips are usually caused by atmospheric perturbations, such as electric discharges generated by lightening, operations performed on the electric distribution network, disturbances generated by industrial equipments and the presence of electronic filters in the electric circuit (also inside of common household appliances) that create permanent leakage currents towards earth.

The problems caused by an untimely trip of a residual current circuit breaker can range, in a domestic environment, from a limited inconvenience due to having to reset the RCCB, to more considerable economic damage due to the loss of the content of a freezer.

In the industrial and tertiary sectors, where the systems are extended and the service continuity must be more guaranteed, the amount of damage is certainly larger; it is sufficient to think of application areas such as photovoltaics, telecommunications, Electronic Data Processing, public lighting or monitoring systems in order to understand how the continuity of electrical services plays a fundamental role for economic return on investment, productivity and public safety.

A possible measure that can be taken to prevent the inappropriate tripping of the circuit breakers would be to install GEWISS **reinforced immunity RCCBs**, which are identified with the letters **IR** and characterised by greater resistance against the causes of the untimely trips, in comparison to standard versions. More specifically, the **IR RCCBs** are able to:

- not trip in the case of atmospheric as well as operational overvoltages because the level of immunity against the impulsive residual current with normalised form 8/20 µs reaches the value of 3000A (for standard versions, the peak values arrives up to 250A);
- not trip in the case of temporary earth leakages that occur when turning on electronic devices equipped with filters present in the power supplies of the most common equipments, such as PCs, decoders, variable speed electronic household appliances (air conditioners, washing machines, etc.), power supplies for lamps and dimmers.

In addition to the characteristics of type IR, **type F** guarantees also protection against indirect contacts due to variable-frequency earth faults which are generated in the presence of a single-phase frequency converter, or inverter, i.e. a device used in domestic and industrial appliances, such as washing machines, vacuum cleaners, dishwashers, ventilation systems, pumps, etc ... to regulate the speed of an electric motor, acting on the voltage and frequency of the power supply. Inverter technology is increasingly widespread in modern equipment because it allows to reduce energy consumption by improving the performance of electric motors.

Unlike the IR type, the **selective RCCB** has a delayed tripping action that cannot be adjusted because it is set according to the Standard CEI EN 61008 and 61009 that supply the table shown hereunder where it is clear the relationship between the fault current and the tripping time. Thanks to the S type RCCB, in case of a leakage fault, it is possible to minimise the parts of the system that are out of service by creating a vertical selectivity between the low sensitivity circuit breaker installed upstream and circuit breakers with higher sensitivity connected downstream (see the above illustration).

| Ti | I [A] | IΔ [A] | Standard values of break time (s) at a residual current (IΔ) | | | | | | | |
|---------------|-----------|-----------|--------------------------------------------------------------|----------|-----------|-----------|--|--|--|--|
| Туре | In [A] | ΙΔ [Α] | 1xl∆ | 2xl∆ | 5xl∆ | 500 A | | | | |
| General | Any value | Any value | 0,3 | 0,15 | 0,04 | 0,04 | | | | |
| S (Selective) | Any value | > 0,030 | 0,13-0,5 | 0,06-0,2 | 0,05-0,15 | 0,04-0,15 | | | | |

In detail, the S type provides total or chronometric selectivity between two devices installed in series. Thanks to the intrinsic delay of the S type, the tripping time of the instantaneous residual current circuit breaker located downstream is always less than the delay time of the S type, which guarantees the perfect coordination between the two devices.



MDC temperature performance

| I /A\ | Temperature | | | | | | | | | | | |
|--------|-------------|------|------|------|------|------|--|--|--|--|--|--|
| In (A) | 10°C | 20°C | 30°C | 40°C | 50°C | 60°C | | | | | | |
| 6 | 7.2 | 6.6 | 6 | 5.7 | 5.3 | 5 | | | | | | |
| 10 | 11.8 | 10.8 | 10 | 9.6 | 9.1 | 8.6 | | | | | | |
| 13 | 14.8 | 14 | 13 | 12.2 | 11.2 | 10.3 | | | | | | |
| 16 | 18.2 | 17.2 | 16 | 15.2 | 14.3 | 13.4 | | | | | | |
| 20 | 22.8 | 21.4 | 20 | 19.5 | 18.9 | 18.4 | | | | | | |
| 25 | 28.5 | 26.8 | 25 | 24 | 23 | 22 | | | | | | |
| 32 | 36.5 | 34.2 | 32 | 30.8 | 29.5 | 28,2 | | | | | | |

MDC power loss per pole

| I= /A\ | | 5 | 1 | 0 | 1 | 3 | 1 | 6 | 2 | 0 | 2 | !5 | 3 | 2 |
|--------|------|------|------|------|------|------|------|------|------|------|------|-----|------|------|
| In (A) | Pole | N | Pole | N | Pole | N |
| R (mΩ) | 29.4 | 2.6 | 20.6 | 2.6 | 14.5 | 2.6 | 8.9 | 2.6 | 6.8 | 2.6 | 4.6 | 2.6 | 3.6 | 2.6 |
| P (W) | 1.06 | 0.09 | 2.06 | 0.26 | 2.45 | 0.44 | 2.28 | 0.67 | 2.72 | 1.04 | 2.88 | 2 | 3.67 | 2.66 |

BD - BDHP add-on for miniature circuit breaker

Add-on for MT (BD) and MTHP (BDHP) miniature circuit breakers, which can be coupled by the installer once only (in compliance with Standard CEI EN 61009, appendix G). AC, A, A[IR] impulse resistant, A[S] selective and adjustable types are available.

BD and BDHP power loss per pole

| Dawer lass (V | M) | Rated current of the associated MT/MTHP miniature circuit breaker [A] | | | | | | | | | | | | | | | | |
|---------------|-------|-----------------------------------------------------------------------|-------|------|------|------|------|------|------|------|------|------|------|------|------|-----|-----|-----|
| Power loss (V | v) | 1 | 2 | 3 | 4 | 6 | 10 | 13 | 16 | 20 | 25 | 32 | 40 | 50 | 63 | 80 | 100 | 125 |
| nn - 44 | 2P | 0.01 | 0.04 | 0.01 | 0.02 | 0.04 | 0.11 | 0.2 | 0.29 | 0.45 | 0.70 | 0.45 | 0.70 | 1.10 | 1.75 | - | - | - |
| BD add-on | 3P-4P | 0.002 | 0.008 | 0.02 | 0.03 | 0.07 | 0.21 | 0.37 | 0.53 | 0.83 | 1.30 | 0.65 | 1.00 | 1.60 | 2.50 | - | - | - |
| BDHP add-on | ı | - | - | - | - | - | - | - | - | 0.2 | 0.3 | 0.5 | 0.8 | 1.25 | 2 | 1.4 | 2.2 | 3.4 |



IDP residual current circuit breakers

Technical characteristics

Two-pole and four-pole residual current circuit breakers without built-in overcurrent releases - free release monobloc.

AC type devices with instantaneous tripping are available (for residual sinusoidal alternating currents only), whereas A type residual current circuit breakers (suitable for residual one-way pulsating currents) are available in instantaneous, impulse-resistant and selective versions.

The range also includes RCCBs type F with the same immunity level of IR type (Impulse Resistant) for the protection of variable-frequency earth faults.

Moreover RCCBs type B with the same immunity level of IR type are available for the protection of electrical loads which can create earth fault currents with a direct component.

IDP temperature performance

| In (A) | Temperature | | | | | | | | | |
|--------|-------------|------|------|------|--|--|--|--|--|--|
| In (A) | 30°C | 40°C | 50°C | 60°C | | | | | | |
| 25 | 25 | 25 | 22,5 | 20 | | | | | | |
| 40 | 40 | 40 | 36 | 32 | | | | | | |
| 63 | 63 | 63 | 56,7 | 50,4 | | | | | | |
| 80 | 80 | 80 | - | - | | | | | | |
| 100 | 100 | 100 | - | - | | | | | | |
| 125 | 125 | 125 | 120 | 110 | | | | | | |


Power loss per device (W)

| | | | | Rated current In (A) | | | |
|-------|----------------|-----|------|----------------------------|------|------|------|
| Poles | No. of modules | 25 | 40 | 63 | 80 | 100 | 125 |
| | | | Тур | e AC, A, A[IR], A[S] and F | | | |
| 2 | 2 | 2,9 | 7,8 | 8,1 | 12,9 | - | - |
| 4 | 3 | 2,4 | 5,9 | - | - | - | - |
| 4 | 4 | 4,4 | 11,7 | 12,2 | 21,6 | 23,4 | 26,7 |
| | | | | Type B | | | |
| 2 | 4 | 1 | 2,6 | 6,2 | - | - | - |
| 4 | 4 | 1,4 | 3,8 | 9,1 | - | - | - |

Composition rules for the modular residual current circuit breakers

In order to obtain a residual current circuit breaker from a miniature circuit breaker, it is necessary to observe these rules:


- 1 there is no residual current device that can be associated with the MTC circuit breakers. There is the MDC compact monobloc residual current circuit breaker with overcurrent protection.
- 2 the BD add-on residual current device can only be associated with the MT circuit breakers.
- 3 the BDHP add-on residual current device can only be associated with the MTHP circuit breakers.

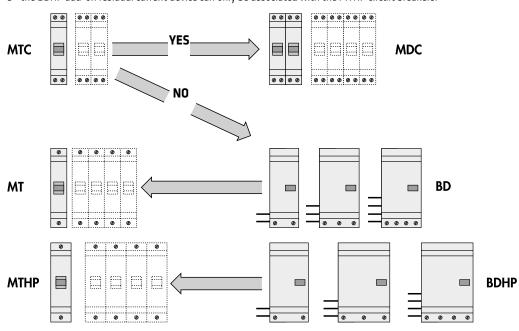





Tripping characteristics


Termo-magnetic release

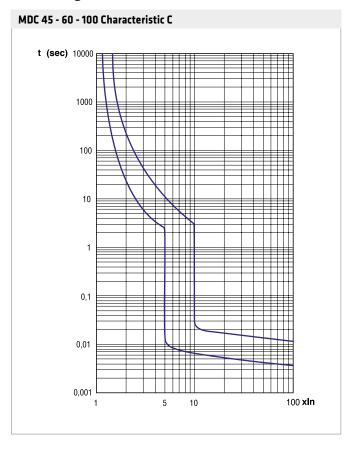


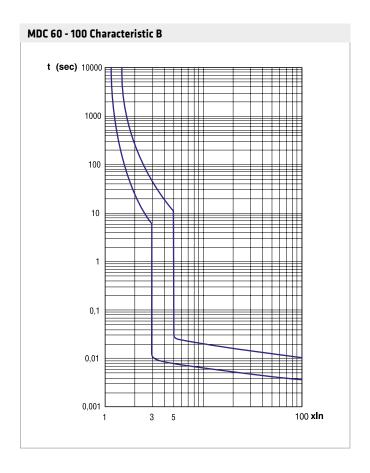

Peak current limitation characteristics

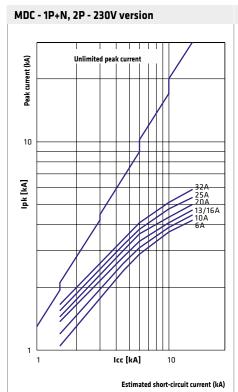

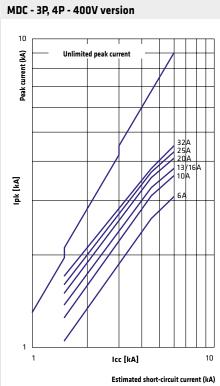






The following curves give the values of the peak current in relation to the estimated short-circuit current expressed in kA. Every curve refers to each rated current value of circuit breaker.





Specific let-through energy characteristics

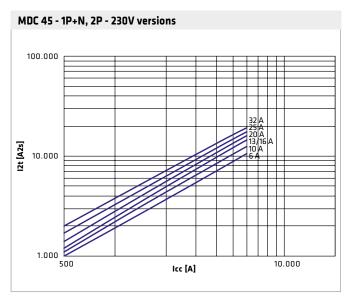


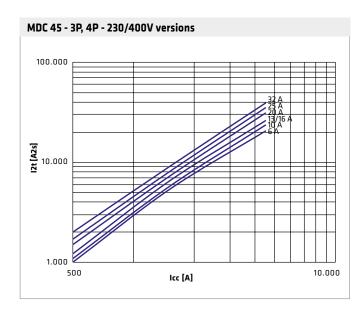

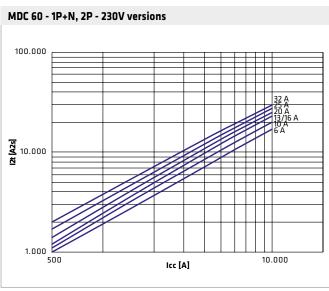

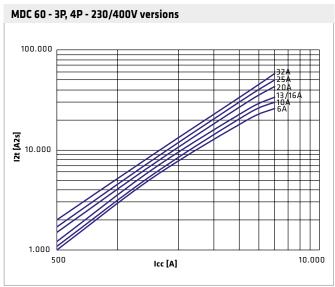

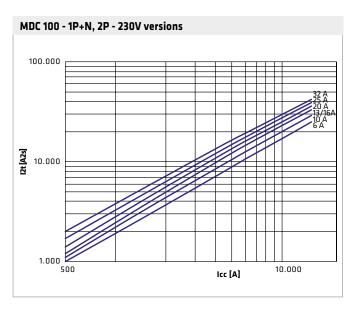


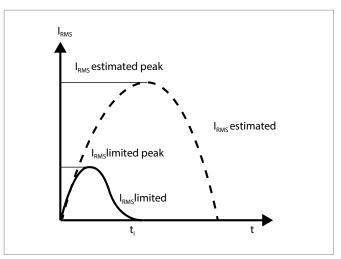

The curves above give the values of the specific let-through energy in relation to the short-circuit current expressed in A. Every curve refers to each rated current value of circuit breaker.



Residual current circuit breaker tripping characteristics

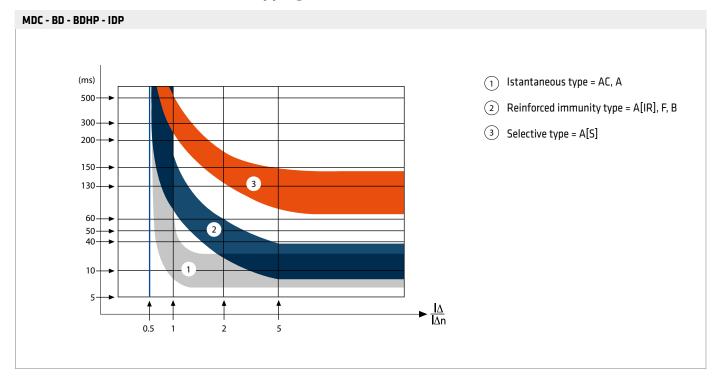

| RCD TYPE | AC | A | F | В | |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------|---------------------------------------|--------------------------------------------------------------|----------------------------------------------------------------------------|----------------------------|
| RESIDUAL FAULT CURRENT TYPE | • Sinusoidal alternating | • Sinusoidal alternating • Pulsanting | Sinusoidal alternating Pulsanting Variable frequency | Alternating sinusoidal Pulsanting Variable frequency Smooth DC | Level of immunity (8/20µs) |
| INSTANTANEOUS First level of residual current protection against direct and indirect contacts | 1 | 1 | | | 250A |
| 2. REINFORCED IMMUNITY Prevention of untimely interventions due to: • overvoltages due to indirect lightning strikes (8/20 µs impulse current waveform up to 3000A) • overvoltages due to maneuvres on electrical network • overvoltages due to earth fault on three-phase system • permanent harmonics due electronic devices (immunity to currents with frequency higher than 50Hz) • starting current (immunity to the ring wave waveform) | | ✓ | ✓ | ✓ | 3000A |
| 3. SELECTIVE Second level of residual-current protection for total or chronometric selectivity with downstream RCDs | | 1 | | | 3000A |





LOCAL RCCB

Technical data

| ТҮРЕ | | | SAFETY SOCK | ET WITH RCCB | | ET WITH RCCB ROTECTED) | RCCB SAI | ETY UNIT |
|--------------------------------------------------|---------------|----------|-----------------|------------------------------------------------------------------|------------|--------------------------------|----------|----------------------|
| | | | | | | 3 | / ma | |
| Standard | | | IEC EN 6 | 61008-1 51008-2-1 0884-1 | IEC EN | 61008-1 51008-2-1 0884-1 | | 61008-1 51008-2-1 |
| Degree of protection | | | IF | P21 | IF | 944 | IF | 941 |
| Type of installation | | | | flush-mounting or surface-mounting (when installed inside the bo | | | | |
| Codes | | | GW95521 | GW95222 | GW95523 | GW95224 | GW95525 | GW95226 |
| Rated residual operating current (I∆n) | | (mA) | 10 | 30 | 10 | 30 | 10 | 30 |
| Rated current (In) | | (A) | | | | 16 | | |
| Rated operational voltage (Ue) | | (V a.c.) | | | 230 | - 240 | | |
| Rated impulse withstand voltage (Uimp) | | (kV) | | | | 4 | | |
| Overvoltage category | | | | | | III | | |
| Rated frequency | | (Hz) | | | ! | 50 | | |
| Poles | | | | | 1F | P+N | | |
| RCCB type | | | | | | A | | |
| Level of immunity (8/20µs) | | (A) | | | 2 | 50 | | |
| Residual making and breaking capacity (Idm) | | (A) | | | 5 | 00 | | |
| Making and breaking capacity (Im) | | (A) | | | 5 | 00 | | |
| Rated conditional residual short-circuit current | t (I∆c) | (A) | | | 3000 (fu | se gG 20A) | | |
| Voltage independent working | | | | | <u> </u> | res | | |
| Wiring | cable | rigid | | | min 1.5 | - max 2.5 | | |
| ····5 | section (mm²) | flexible | | | min 1.5 | - max 2.5 | | |
| Electrical endurance | | | | | 61 | 000 | | |
| Mechanical endurance | | | | | 10 | 000 | | |
| Type of terminal | | | | | Scre | wless | | |
| Pollution degree | | | | | | 2 | | |
| Tropicalization | | | | | 55°C - | RH 95% | | |
| Operating temperature | | (°C) | | | -25 ÷ + 40 | | | |
| Storage temperature | | (°C) | | | -40 | ÷ + 70 | | |
| Weight | | (g) | (g) 155 165 145 | | | | | |

Dimension tables

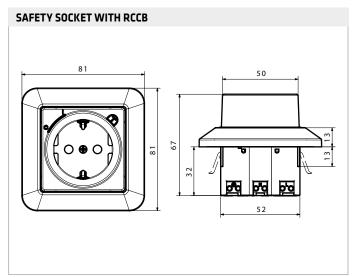

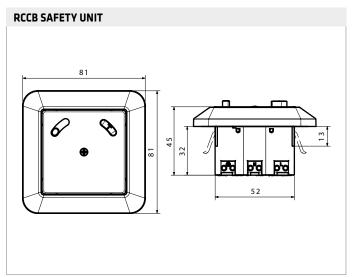



Dimension tables

